



FSD-TD Series

Fire and Smoke Dampers



The NEW FSD-TD damper has been extensively tested gaining certification and approvals to ensure that it complies with the current Fire Regulations and Building Regulations applicable to Fire Damper installation.

- LPCB certificated fire dampers (LPS 1162)
- ES classified fire dampers with reduced smoke leakage characteristics (BS EN 13501-3)
- Tested installation methods in differing supporting constructions (BS EN 1366-2)
- Able to respond to smoke alarms for the protection of escape routes and areas with sleeping risk (ADB)
- Able to be controlled by smoke and fire control systems (BSB damper control panels)
- Tested and assessed installation methods in differing supporting constructions (BS 476-20/22)



FSD-TD Series

Fire and Smoke Dampers





Model FSD-TD - S

Square/Rectangular
Spigot Connection

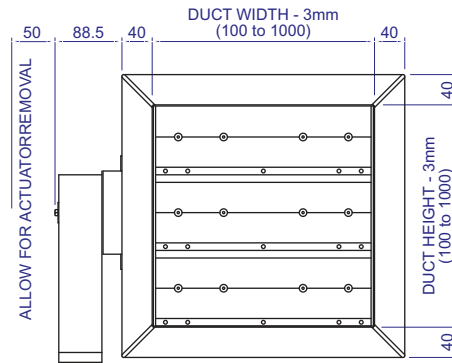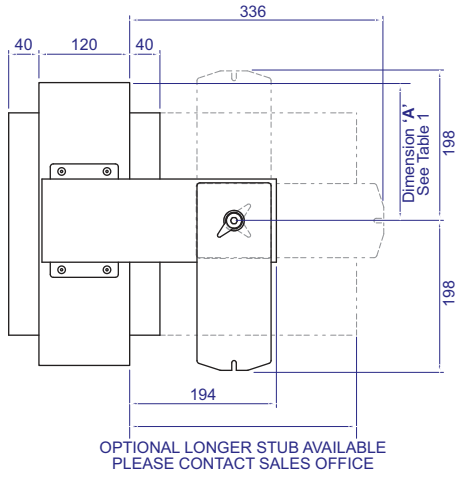



Model FSD-TD - C

Circular Spigot
Connection

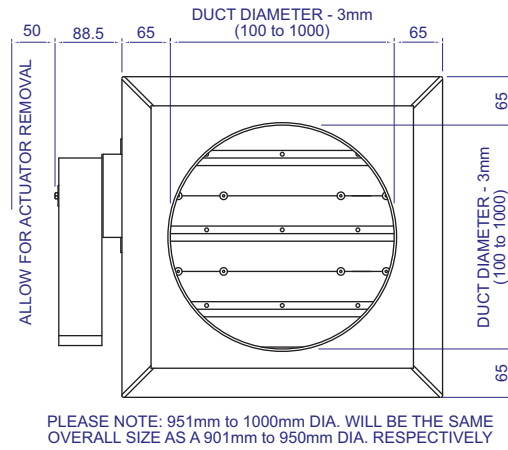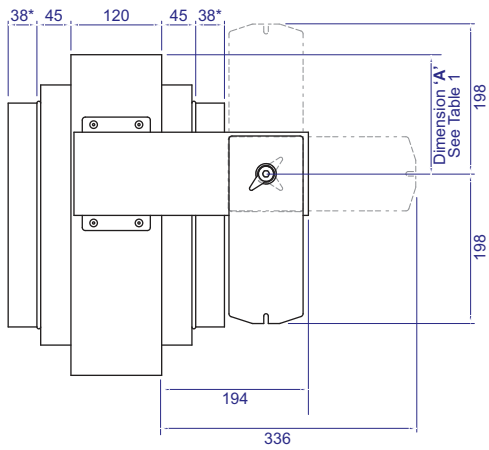

Model FSD-TD - O

Flat Oval Spigot
Connection

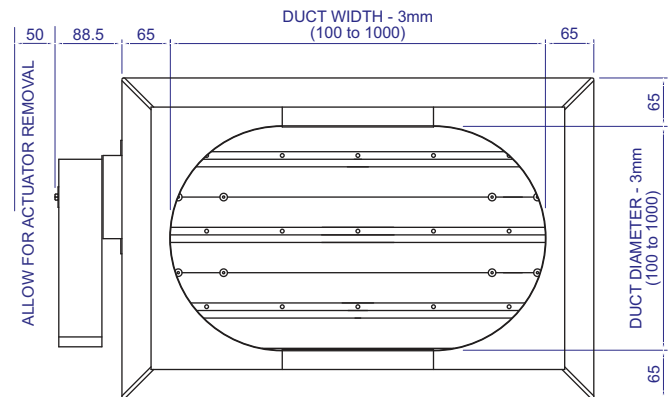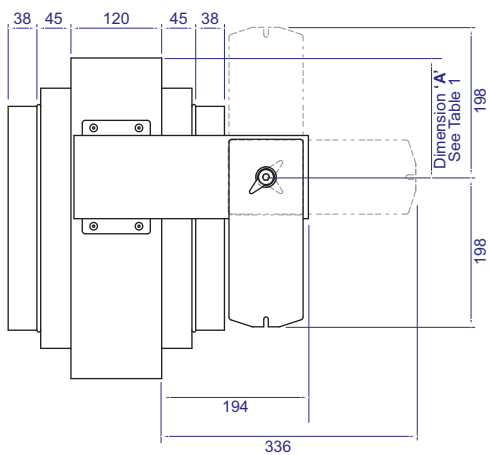

LPS 1162 Certificate No. 828A

